


How to calibrate for MT8000 X series

MT8000 X series HMIs are able to active calibration on the touch screen.

Step 1. Connect a USB mouse on MT8000 X HMI

Step 2. Go to system setting bar

Step 3. Click  calibration button to start calibration function.

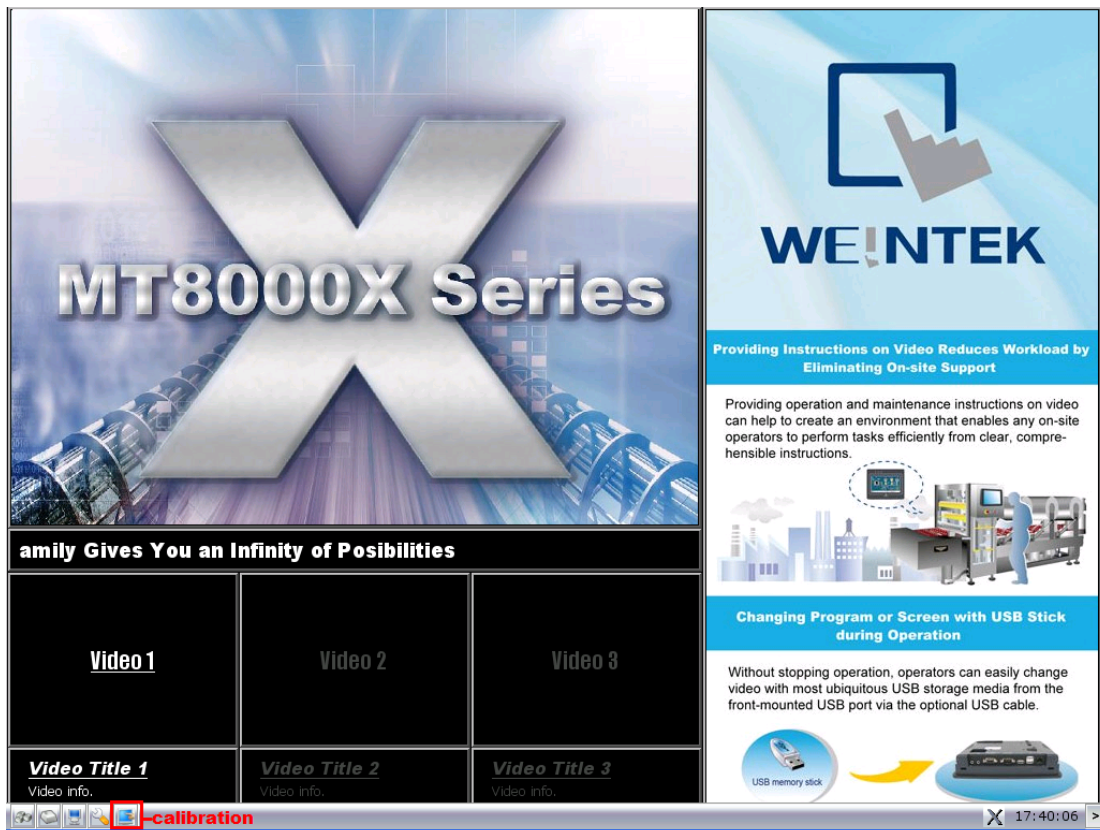

The screenshot displays the MT8000X Series HMI interface. The main display area features a large 'X' graphic and the text 'MT8000X Series'. Below this, a section titled 'amily Gives You an Infinity of Possibilities' contains three video selection buttons: 'Video 1', 'Video 2', and 'Video 3'. Each button has a corresponding title and 'Video info.' text below it. At the bottom left, there is a 'calibration' button with a red box around it. The right side of the screen shows a sidebar with the WEINTEK logo and two informational sections: 'Providing Instructions on Video Reduces Workload by Eliminating On-site Support' and 'Changing Program or Screen with USB Stick during Operation'. The bottom status bar shows the time as 17:40:06.